

To: Village Board

From: Clay Laubach Water Plant Operator.

RE: August monthly report

Submitted for September 18th, 2026

Water Plant

- 1) Timber harvesting clean up needs to be inspected, Reaching out to meet with Lukas.
- 2) DEC land sale, Survey is near completion. Meeting with Mike Carrol to adjust the boundaries around Mang reservoir and Cold Brook Reservoir. Discussing the possibility to keep the access road from Irondale to North Rd. as a maintenance road for the Water Plant to easily access parts of the watershed.
- 3) Water Meter, working with the team to help keep it moving forward.
- 4) Cold Brook reservoir has been evacuated and cleaned out week of 8-3-2026
- 5) Administered extra security measures to our water plants' SCADA and computer systems to comply with DOH-DEC Cyber Security concerns
- 6) Quarterly Disinfection byproducts passed HAA5- 28.2 THHM-16.8

Attachments


- 1) August 2026 water plant flow report.

Respectfully,


Clay Laubach, Water Plant Operator.

Aug-26	Filter Flow (gpd)	Effluent Flow (gpd)	Precip. (in.)	Filter Bed Turbidity NTU	Raw Water Turbidity NTU	Cleanwell level	Village CL2 Residual mg/l	Village Turbidity NTU	Entry Point CL2 Residual mg/l	CL2 Tank Weight (lbs)	(lbs) CL2 Used/Day	Phosp. Residual (mg/l)
1	500968.00	427107.00	-	0.048	0.143	10.470	0.52		0.76	8	9.0	
2	455235.00	425830.00	-	0.045	0.120	11.220	0.53		0.80	0	8.0	
3	460277.00	509868.00	0.70	0.046	0.229	11.380	0.54	0.053	0.92	-2/144	8.0	0.68
4	488011.00	481962.00	0.20	0.045	0.237	10.880	0.35	0.139	1.09	135	9.0	
5	499255.00	544441.00	-	0.045	0.115	10.420	0.55	0.086	0.97	126	9.0	
6	511019.00	479866.00	-	0.043	0.109	10.380	0.38	0.106	0.98	118	8.0	
7	488438.00	457776.00	0.20	0.043	0.093	10.770	0.31	0.156	1.01	109	9.0	
8	456579.00	411156.00	-	0.042	0.197	11.190	0.64		1.07	100	9.0	
9	284358.00	422739.00	0.40	0.041	0.164	11.570	0.71		1.08	91	9.0	
10	478211.00	587447.00	-	0.041	0.131	11.570	0.73	0.051	1.17	82	8.0	0.52
11	537553.00	567142.00	-	0.043	0.146	10.420	0.51	0.043	0.90	74	8.0	
12	555205.00	570754.00	-	0.041	0.138	10.100	0.49	0.125	1.20	66	8.0	
13	566171.00	563320.00	0.10	0.042	0.126	9.950	0.45	0.121	1.01	59	7.0	
14	551890.00	535343.00	-	0.041	0.120	10.040	0.76	0.061	0.97	51	8.0	
15	511800.00	415635.00	-	0.040	0.123	10.310	0.68		1.01	42	8.0	
16	455990.00	424764.00	-	0.040	0.120	11.190	0.69		1.13	36	6.0	
17	478906.00	569967.00	0.20	0.041	0.118	11.240	0.8		1.14	27	9.0	
18	553629.00	619197.00	0.50	0.041	0.144	10.440	0.61	0.05	0.82	20	7.0	0.43
19	601918.00	580703.00	-	0.041	0.112	9.620	0.56	0.24	0.91	12	8.0	
20	584276.00	539712.00	-	0.042	0.100	10.030	0.48	0.101	0.81	5	7.0	
21	546006.00	547825.00	-	0.042	0.098	10.550	0.58	0.106	0.87	-2	7.0	
22	509185.00	413319.00	-	0.041	0.097	8.820	0.55		0.91	143	7.0	
23	450521.00	412889.00	0.10	0.041	0.093	11.500	0.58	0.062	1.03	137	6.0	
24	463337.00	513067.00	0.10	0.040	0.101	11.390	0.81	0.072	1.04	130	7.0	0.96
25	498917.00	536306.00	0.10	0.040	0.094	11.150	0.47	0.112	1.04	124	6.0	
26	524915.00	533486.00	0.20	0.039	0.105	10.760	0.35	0.111	1.00	116	8.0	
27	538963.00	550100.00	-	0.041	0.096	10.570	0.68	0.085	0.96	110	6.0	
28	532962.00	501690.00	0.30	0.041	0.108	10.530	0.5	0.072	0.92	103	7.0	
29	496741.00	431754.00	-	0.042	0.102	10.890	0.69		0.92	96	7.0	
30	348984.00	410488.00	-	0.041	0.099	11.590	0.64		0.98	89	7.0	
31	345844.00	521628.00	0.10	0.041	0.103	11.610	0.88	0.059	1.07	83	6.0	1.04
Total	15,276,064	15,507,281	3.20								236.0	
Average	492,776	500,235		0.042	0.125	10.73	0.58	0.096	0.98		7.6	0.73

Dolgeville Water Plant Filter Bed Performance August 2026

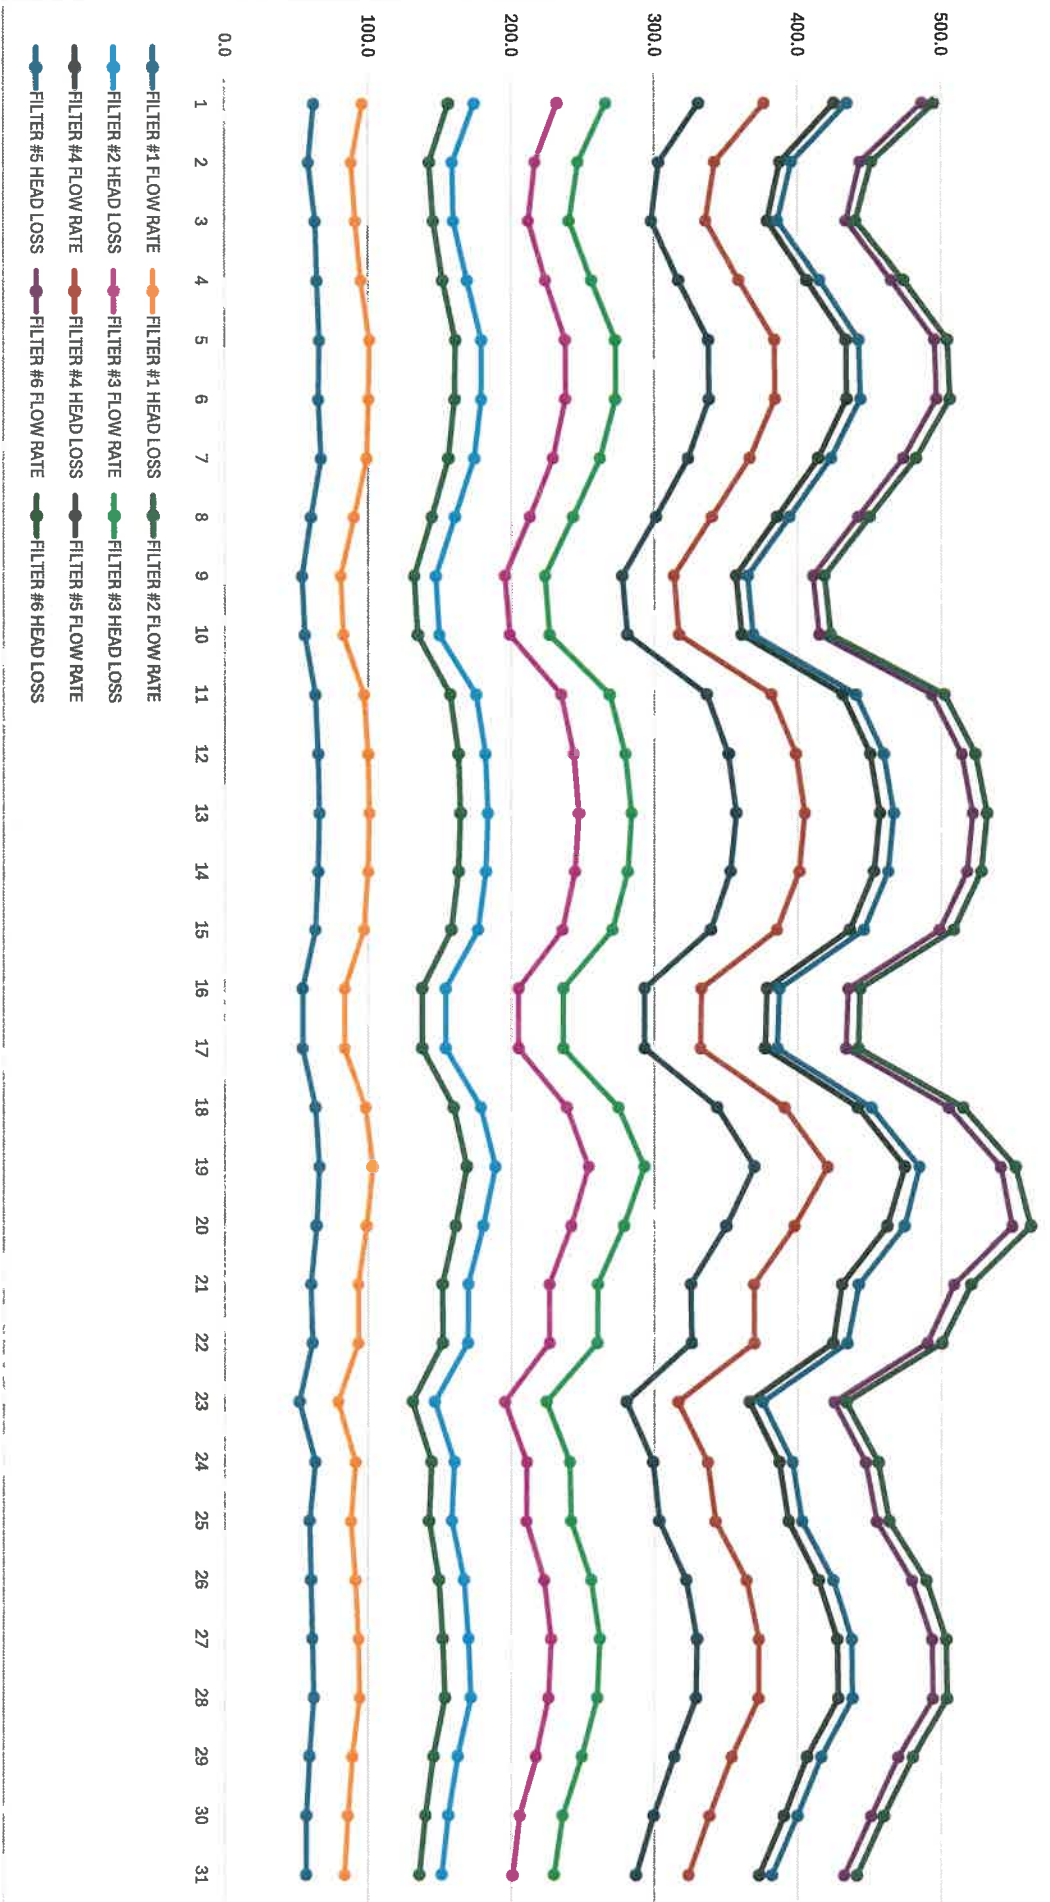

Dolgeville Water Plant Chlorine Residual August 2026

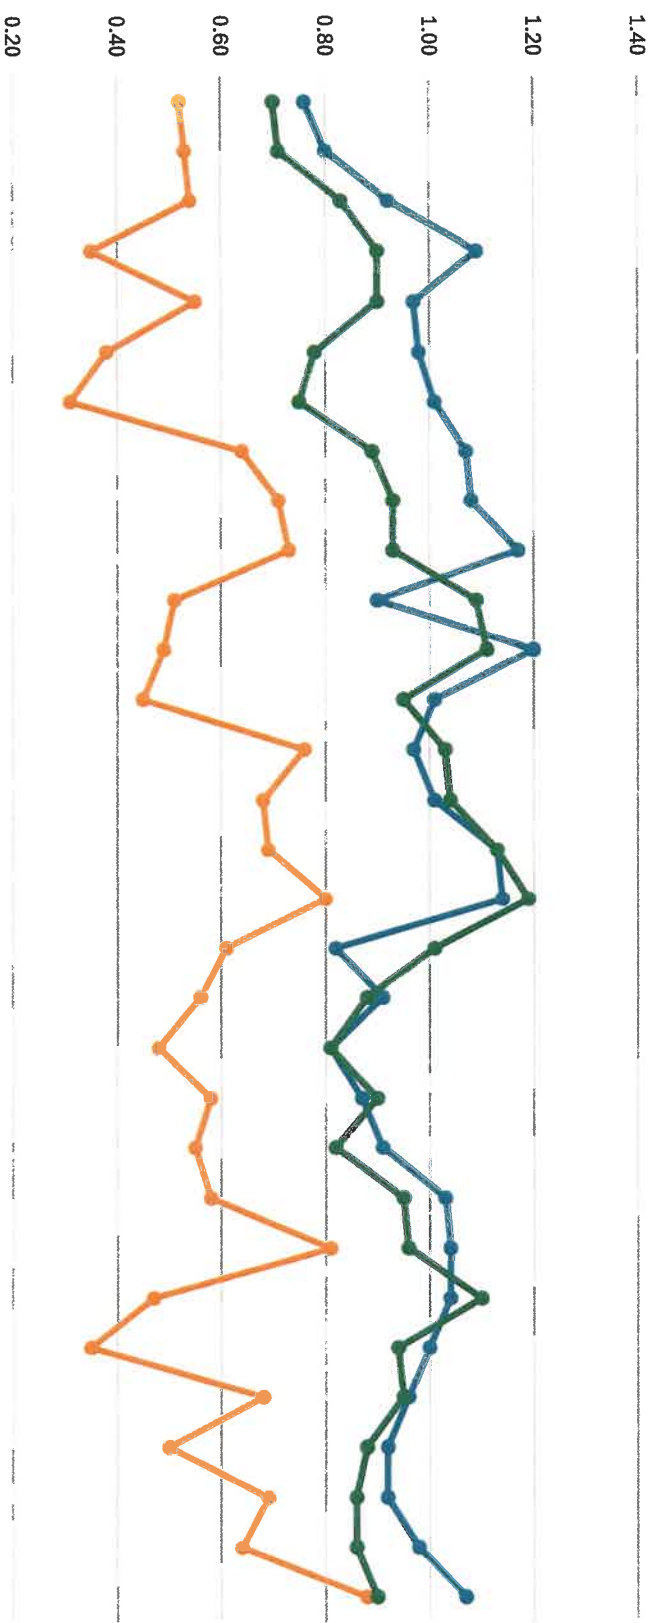

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Analyzer Residual	0.76	0.80	0.92	1.09	0.97	0.98	1.01	1.07	1.08	1.17	0.90	1.20	1.01	0.97	1.01	1.13	1.14	0.82	0.91	0.81	0.87	0.91	1.03	1.04	1.04	1.00	0.96	0.92	0.92	0.98	1.07
Cl2 Dist. Residual	0.52	0.53	0.54	0.35	0.55	0.38	0.31	0.64	0.71	0.73	0.51	0.49	0.45	0.76	0.68	0.69	0.8	0.61	0.56	0.48	0.58	0.55	0.58	0.81	0.47	0.35	0.68	0.5	0.69	0.64	0.88
Benchmark	0.70	0.71	0.83	0.90	0.90	0.78	0.75	0.89	0.93	0.93	1.09	1.11	0.95	1.03	1.04	1.13	1.19	1.01	0.88	0.81	0.90	0.82	0.95	0.96	1.10	0.94	0.95	0.88	0.86	0.86	0.90

—●— Analyzer Residual
 —●— Cl2 Dist. Residual
 —●— Benchmark

Dolgeville Water Plant Daily Flow August 2026

